


NOTE:  
1. REMOVE JUMPER WHEN CONNECTING A SECOND REMOTE PANEL.

NOTE:  
○ REMOTE CONECTOR PINS

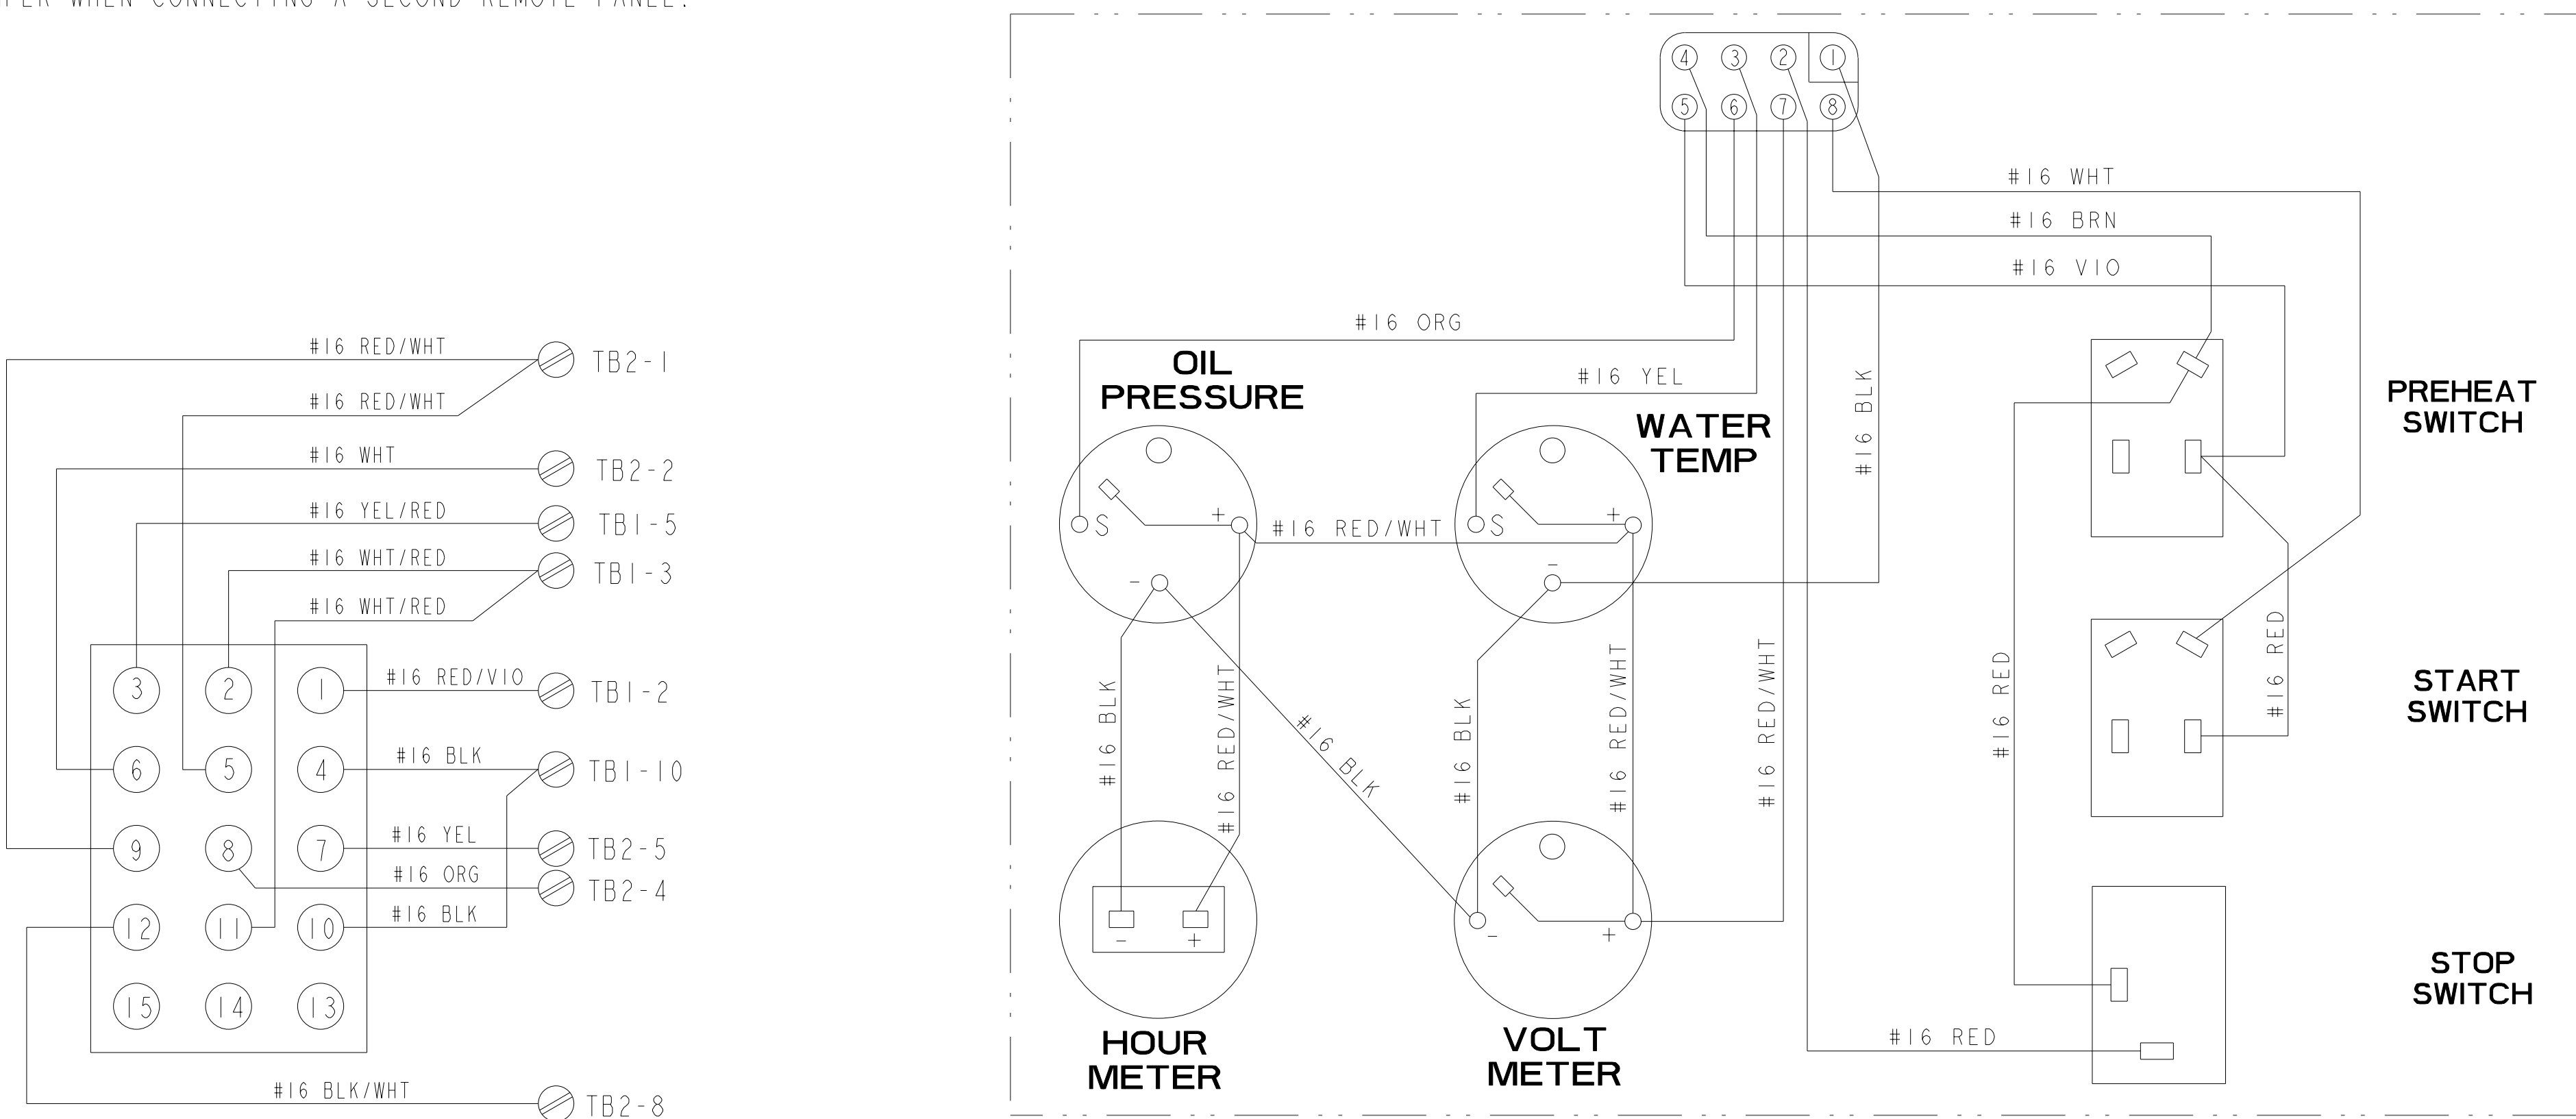

**INSTRUMENT PANEL**

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
5082	10/24	C	ADDED CURRENT TIMER	TSM	
4737	11/6	B	#10 ORANGE WAS #10 RED, #12 VIO/RED WAS #12 VIO REROUTED WIRE FROM PREHEAT SOLENOID TO STARTER	JRS	
4632	7/12	A	UPDATED ALTERNATOR WIRING SCHEMATIC. WIRE #10 RED WAS #10 ORN. WIRE #12 VIO WAS #12 VIO/RED. WIRE #16 RED REROUTED FROM STARTER TO 20 AMP CIRCUIT BREAKER.	TSM	

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION AVON MA. 02322	
INCHES	MILLIMETERS	TITLE	
XX : .00	XX :	WIRING DIAGRAM/SCHEMATIC,	
XX : .005	XX :	7.6 BTDR - SRC	
XX : .01	XX :	DATE	MATERIAL:
XX : .02	XX :	16/MAY/00	
XX : .03	XX :	APPROVED BY	DATE
XX : .04	XX :		
XX : .05	XX :	SCALE NONE	SIZE DRAWING NUMBER
XX : .06	XX :		
XX : .07	XX :		
XX : .08	XX :		
XX : .09	XX :		
XX : .10	XX :		
XX : .12	XX :		
XX : .15	XX :		
XX : .20	XX :		
XX : .25	XX :		
XX : .30	XX :		
XX : .375	XX :		
XX : .50	XX :		
XX : .625	XX :		
XX : .75	XX :		
XX : .875	XX :		
XX : 1.00	XX :		
XX : 1.25	XX :		
XX : 1.50	XX :		
XX : 1.75	XX :		
XX : 2.00	XX :		
XX : 2.50	XX :		
XX : 3.00	XX :		
XX : 3.75	XX :		
XX : 4.50	XX :		
XX : 5.00	XX :		
XX : 6.00	XX :		
XX : 7.00	XX :		
XX : 8.00	XX :		
XX : 9.00	XX :		
XX : 10.00	XX :		
XX : 12.00	XX :		
XX : 15.00	XX :		
XX : 20.00	XX :		
XX : 25.00	XX :		
XX : 30.00	XX :		
XX : 37.50	XX :		
XX : 45.00	XX :		
XX : 50.00	XX :		
XX : 60.00	XX :		
XX : 75.00	XX :		
XX : 90.00	XX :		
XX : 100.00	XX :		

SHT. 1 of 1 **E 44743** C